SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to SS-EN ISO 354 and ISO 20189

Client:	Abstracta		
Object:	Scala Wall		
Size [mm]:	w = 1207	h = 1600	d = 20

1/3 octave band (Hz)	Equivalent sound absorption area / unit (m2Sabine)
63	0
125	0.21
250	0.77
500	1.94
1000	2.29
2000	1.91
4000	2.19
N_{10} =	5

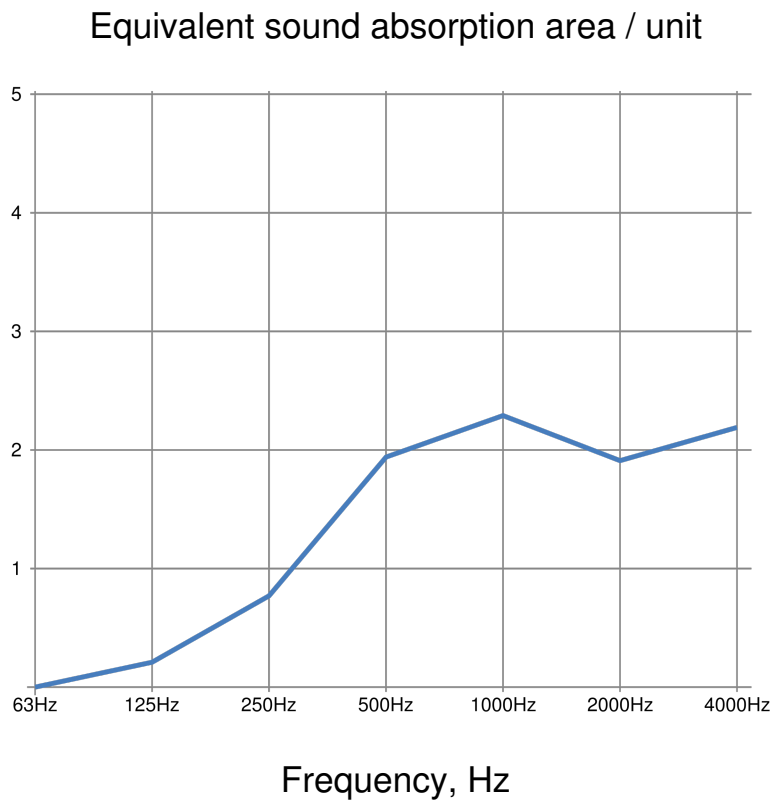

CONDITIONS

Date of test:	2017-03-14	Object volume:	0.04	m^3
Date:	2019-02-28	Rev. room volume:	200	m^3

Test report: KTH-MWL LW20170314_R2

Signature: Lars Wester